
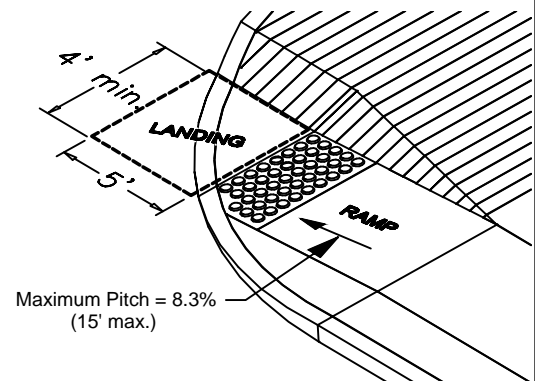


Type "A"

Type "B" Ramp Not Approved

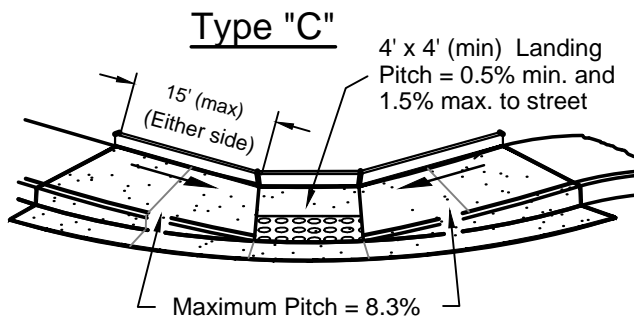

NOTES:

1. Ramp cross slopes and landing slopes shall not exceed 1.5%.
2. Ramps shall be flush with the gutter flow line. Maintain 5% (max.) gutter slope at ramp.
3. Curb Ramps are required with all curb types.
4. Detectable warning strips shall consist of a 24" x [Ramp Width] truncated-dome style surface installed full width of ramp (at least one corner of leading edge shall be within 6" of the face of curb, but no other point on the leading edge of the warning strip shall be greater than 5' from back of curb. Color shall be Federal Yellow.
5. Construction of Type C ramps is allowed only where site conditions prevent construction of Type A. ramps; obtain Engineer's approval before constructing Type C ramps.

P:\Engr & CAD\STANDARD DWGS - ALL YEARS\Std Dwgs 2014\Curb Ramp 9.dwg

PARALLEL CURB RAMP

CURB RAMP DETAILS

PAGE NO:

9

CITY OF PULLMAN
ENGINEERING DIVISION

ADOPTED: 12-09-2014